



**100% PURE SINE WAVE HOME INVERTER**

# USER'S MANUAL

## SOLAR INVERTER

**2.2KW- 4KW**

The software supports installation on Windows systems.  
Scan the QR code for download or visit the website for  
downloading: <https://sw.mustpower.com>



Appliances



PC



TV



Air-  
conditioning



Fridge



Washing  
machine

4200-010025-0500

# Table Of Contents

|                                                 |    |
|-------------------------------------------------|----|
| <b>ABOUT THIS MANUAL</b>                        | 1  |
| Purpose                                         | 1  |
| Scope                                           | 1  |
| <b>SAFETY INSTRUCTIONS</b>                      | 1  |
| <b>INTRODUCTION</b>                             | 2  |
| Features                                        | 2  |
| Basic System Architecture                       | 2  |
| Product Overview                                | 3  |
| <b>INSTALLATION</b>                             | 4  |
| Unpacking and Inspection                        | 4  |
| Preparation                                     | 4  |
| Mounting the Unit                               | 4  |
| Battery Connection                              | 5  |
| AC Input/Output Connection                      | 6  |
| PV Connection                                   | 8  |
| Final Assembly                                  | 9  |
| Communication Connection                        | 10 |
| Dry Contact Signal                              | 10 |
| <b>OPERATION</b>                                | 11 |
| Power ON/OFF                                    | 11 |
| Operation and Display Panel                     | 11 |
| LCD Display Icons                               | 12 |
| LCD Setting                                     | 14 |
| Fault Reference Code                            | 19 |
| Warning Indicator                               | 20 |
| Operating Mode Description                      | 21 |
| Display Setting                                 | 22 |
| <b>SPECIFICATIONS</b>                           | 23 |
| Table 1 Line Mode Specifications                | 23 |
| Table 2 Inverter Mode Specifications            | 24 |
| Table 3 Charge Mode Specifications              | 25 |
| Table 4 General Specifications                  | 26 |
| <b>TROUBLE SHOOTING</b>                         | 27 |
| <b>Appendix: Approximate Back-up Time Table</b> | 28 |

## ABOUT THIS MANUAL

### Purpose

This manual describes the assembly, installation, operation and troubleshooting of this unit. Please read this manual carefully before installations and operations. Keep this manual for future reference.

### Scope

This manual provides safety and installation guidelines as well as information on tools and wiring.

### The following cases are not within the scope of warranty:

- (1) Out of warranty.
- (2) Series number was changed or lost.
- (3) Battery capacity was declined or external damaged.
- (4) Inverter was damaged caused of transport shift, remissness, ect external factor.
- (5) Inverter was damaged caused of irresistible natural disasters.
- (6) Not in accordance with the electrical power supply conditions or operate environment caused damage.

## SAFETY INSTRUCTIONS



**WARNING: This chapter contains important safety and operating instructions. Read and keep this manual for future reference.**

1. Before using the unit, read all instructions and cautionary markings on the unit, the batteries and all appropriate sections of this manual.
2. **CAUTION** --To reduce risk of injury, charge only deep-cycle lead acid type rechargeable batteries. Other types of batteries may burst, causing personal injury and damage.
3. Do not disassemble the unit. Take it to a qualified service center when service or repair is required. Incorrect re-assembly may result in a risk of electric shock or fire.
4. To reduce risk of electric shock, disconnect all wirings before attempting any maintenance or cleaning. Turning off the unit will not reduce this risk.
5. **CAUTION** – Only qualified personnel can install this device with battery.
6. **NEVER** charge a frozen battery.
7. For optimum operation of this inverter/charger, please follow required spec to select appropriate cable size. It's very important to correctly operate this inverter/charger.
8. Be very cautious when working with metal tools on or around batteries. A potential risk exists to drop a tool to spark or short circuit batteries or other electrical parts and could cause an explosion.
9. Please strictly follow installation procedure when you want to disconnect AC or DC terminals. Please refer to INSTALLATION section of this manual for the details.
10. Fuses (1 piece of 150A,63VDC for 2.2KW and 3.2KW/200A,63VDC for 3.5KW and 4KW) are provided as over-current protection for the battery supply.
11. **GROUNDING INSTRUCTIONS** -This inverter/charger should be connected to a permanent grounded wiring system. Be sure to comply with local requirements and regulation to install this inverter.
12. **NEVER** cause AC output and DC input short circuited. Do NOT connect to the mains when DC input short circuits.
13. **Warning!!** Only qualified service persons are able to service this device. If errors still persist after following troubleshooting table, please send this inverter/charger back to local dealer or service center for maintenance.

## INTRODUCTION

This is a multi-function inverter/charger, combining functions of inverter, solar charger and battery charger to offer uninterruptible power support with portable size. Its comprehensive LCD display offers user-configurable and easy-accessible button operation such as battery charging current, AC/solar charger priority, and acceptable input voltage based on different applications.

## Features

- Pure sine wave inverter
- Configurable input voltage range for home appliances and personal computers via LCD setting
- Configurable battery charging current based on applications via LCD setting
- Configurable AC/Solar Charger priority via LCD setting
- Compatible to mains voltage or generator power
- Auto restart while AC is recovering
- Overload/ Over temperature/ short circuit protection
- Smart battery charger design for optimized battery performance
- Cold start function

## Basic System Architecture

The following illustration shows basic application for this inverter/charger. It also includes following devices to have a complete running system:

- Generator or Utility.
- PV modules (option)

Consult with your system integrator for other possible system architectures depending on your requirements.

This inverter can power all kinds of appliances in home or office environment, including motor-type appliances such as tube light, fan, refrigerator and air conditioner.





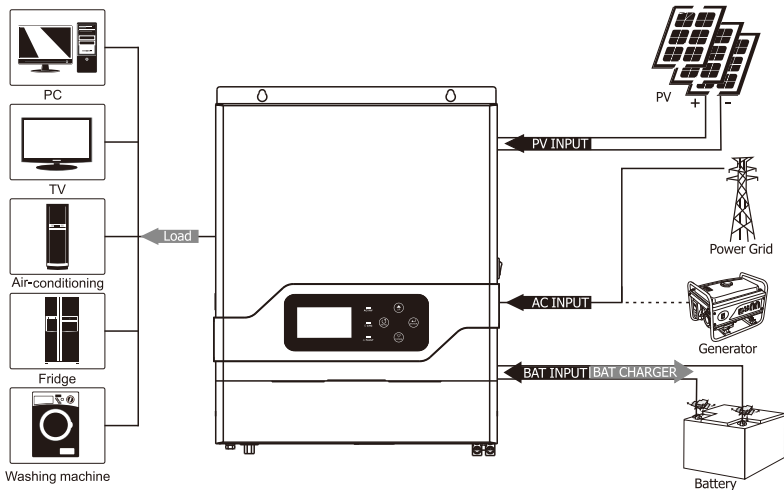


Figure 1 Hybrid Power System

Product Overview

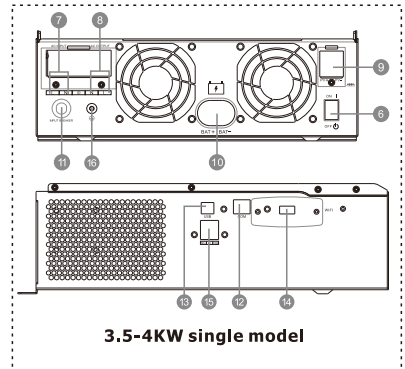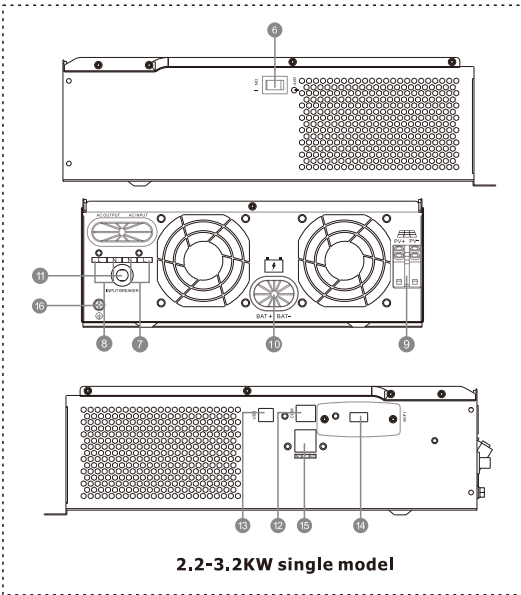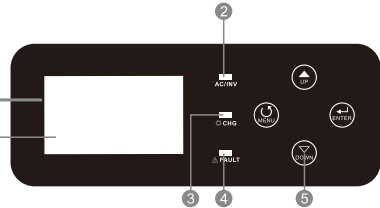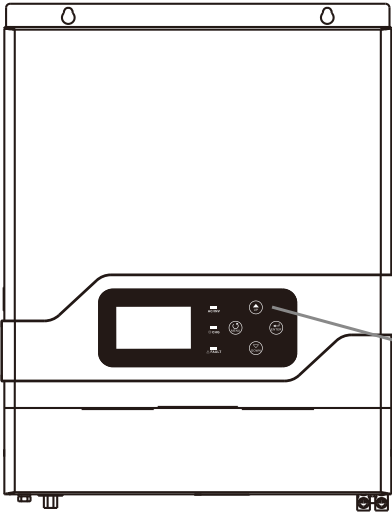

1. LCD display
2. Status indicator
3. Discharging/Charging indicator
4. Fault indicator
5. Function buttons
6. Power on/off switch
7. AC input
8. AC output
9. PV input
10. Battery input
11. Circuit breaker
12. RS-485,CAN communication port
13. USB
14. WIFI (option)
15. Dry Contact
16. Ground

## INSTALLATION


### Unpacking and Inspection

Before installation, please inspect the unit. Be sure that nothing inside the package is damaged. You should have received the following items inside of package:

- The unit x 1
- User manual x 1
- USB cable x 1

### Preparation


Before connecting all wirings, please take off bottom cover by removing two screws as shown below.

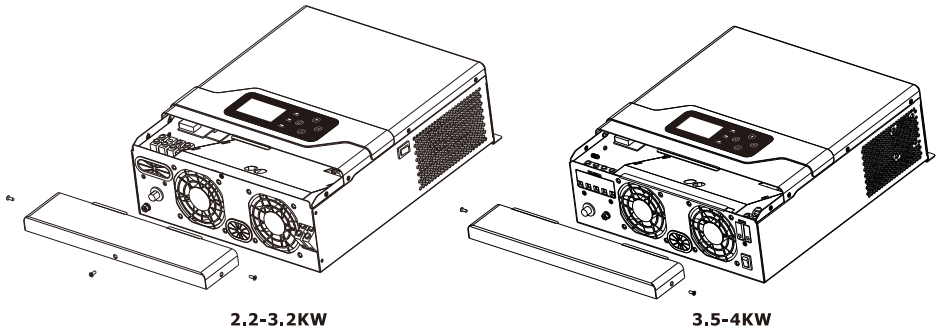

### Mounting the Unit


Consider the following points before selecting where to install:

- Do not mount the inverter on flammable construction materials.
- Mount on a solid surface
- Install this inverter at eye level in order to allow the LCD display to be read at all times.
- For proper air circulation to dissipate heat, allow a clearance of approx. 200 mm to the side and approx. 300 mm above and below the unit.
- The ambient temperature should be between  $-10^{\circ}\text{C}$  and  $50^{\circ}\text{C}$  to ensure optimal operation.
- The recommended installation position is to be adhered to the wall vertically.
- Be sure keep other objects and surfaces as shown in the below diagram to guarantee sufficient heat dissipation and to have enough space for removing wires.

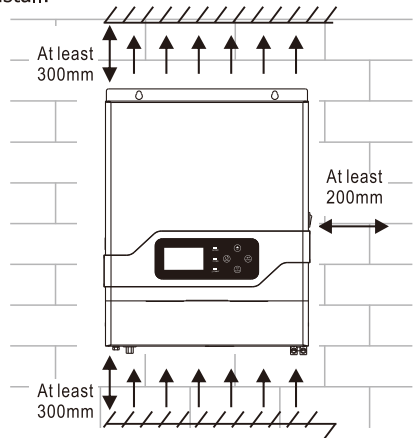

**SUITABLE FOR MOUNTING ON CONCRETE OR OTHER NON-COMBUSTIBLE SURFACE ONLY.**

Install the unit by screwing two screws.

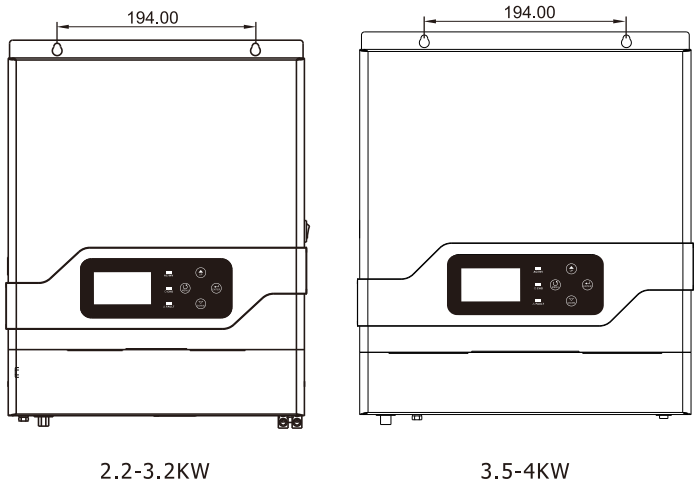


**Battery Connection**

**CAUTION:** To safety operation and regulation compliance, it's requested to install a separate DC over-current protector or disconnect device between battery and inverter. It may not be requested to have a disconnect device in some applications, however, it's still requested to have over-current protection installed. Please refer to typical amperage in below table as required fuse or beaker size.

**WARNING!** All wiring must be performed by a qualified personnel.

**WARNING!** It's very important for system safety and efficient operation to use appropriate cable for battery connection. To reduce risk of injury, please use the proper recommended cable and terminal size as below.

Ring terminal:




**Recommended battery cable and terminal size:**


| Model | Typical Amperage | Battery capacity | Wire Size |
|-------|------------------|------------------|-----------|
| 2.2KW | 100A             | 100AH            | 1*6AWG    |
|       |                  | 200AH            | 2*6AWG    |
| 3.2KW | 140A             | 100AH            | 1*4AWG    |
|       |                  | 200AH            | 2*6AWG    |
| 3.5KW | 153A             | 100AH            | 2*4AWG    |
|       |                  | 200AH            | 2*4AWG    |
| 4KW   | 175A             | 100AH            | 2*4AWG    |
|       |                  | 200AH            | 2*4AWG    |

Please follow below steps to implement battery connection:

1. Assemble battery ring terminal based on recommended battery cable and terminal size.
2. 2.2KW/3.2KW/3.5KW/4KW model supports 24VDC system. Connect all battery packs as below chart, It's suggested to connect at least 100Ah capacity battery for 2.2KW-4KW model.

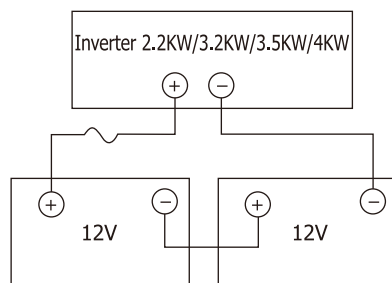

3. Insert the ring terminal of battery cable flatly into battery connector of inverter and make sure the bolts are tightened with torque of 2-3 Nm. Make sure polarity at both the battery and the inverter/charge is correctly connected and ring terminals are tightly screwed to the battery terminals.

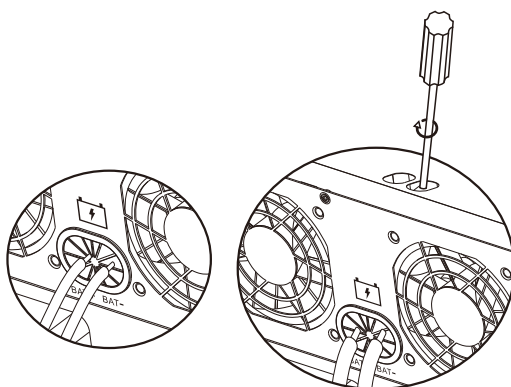

**WARNING: Shock Hazard**

Installation must be performed with care due to high battery voltage in series.



**CAUTION!!** Do not place anything between the flat part of the inverter terminal and the ring terminal. Otherwise, overheating may occur.

**CAUTION!!** Do not apply anti-oxidant substance on the terminals before terminals are connected tightly.

**CAUTION!!** Before making the final DC connection or closing DC breaker/disconnector, be sure DC (+) must be connected to DC (+) and DC (-) must be connected to DC (-).

**AC Input/Output Connection**

**CAUTION!!** Before connecting to AC input power source, please install a separate AC breaker between inverter and AC input power source. This will ensure the inverter can be securely disconnected during maintenance and fully protected from over current of AC input. The recommended spec of AC breaker is 20A for 2.2KW, 32A for 3.2KW/3.5KW/4KW.

**CAUTION!!** There are two terminal blocks with "IN" and "OUT" markings. Please do NOT-misconnect Input and output connectors.

**WARNING!** All wiring must be performed by a qualified personnel.  
**WARNING!** It's very important for system safety and efficient operation to use appropriate cable for AC input connection. To reduce risk of injury, please use the proper recommended cable size as below.

**Suggested cable requirement for AC wires**

| Model           | Gauge | Torque Value |
|-----------------|-------|--------------|
| 2.2KW           | 14AWG | 0.8~1.0Nm    |
| 3.2KW/3.5KW/4KW | 12AWG | 1.2~1.6Nm    |


Please follow below steps to implement AC input/output connection:

1. Before making AC input/output connection, be sure to open DC protector or disconnecter first.
2. Remove insulation sleeve 10mm for six conductors. And shorten phase L and neutral conductor N 3 mm.
3. Insert AC input wires according to polarities indicated on terminal block and tighten the terminal screws. Be sure to connect PE protective conductor (⊕) first.


⊕ → **Ground (yellow-green)**

L → **LINE (brown or black)**

N → **Neutral (blue)**

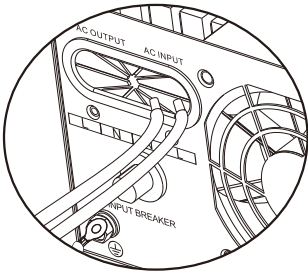

2.2-3.2KW

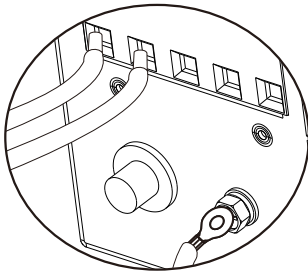

3.5-4KW


**WARNING:**  
Be sure to that AC power source is disconnected before attempting to hardwire it to the unit.

4. Then, insert AC output wires according to polarities indicated on terminal block and tighten terminal screws. Be sure to connect PE protective conductor (⊕) first.


⊕ → **Ground (yellow-green)**

L → **LINE (brown or black)**

N → **Neutral (blue)**

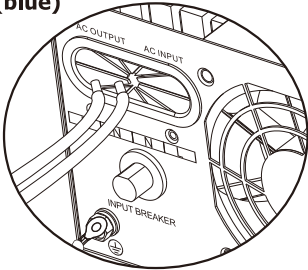

2.2-3.2KW

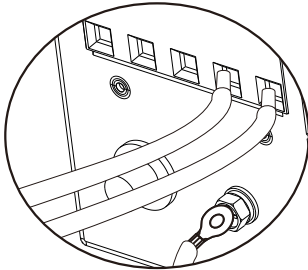

3.5-4KW

5. Make sure the wires are securely connected.

**CAUTION: Important**  
Be sure to connect AC wires with correct polarity. If L and N wires are connected reversely, it may cause utility short-circuited when these inverters are working in parallel operation.

**CAUTION:** Appliances such as air conditioner are required at least 2~3 minutes to restart because it's required to have enough time to balance refrigerant gas inside of circuits. If a power shortage occurs and recovers in a short time, it will cause damage to your connected appliances. To prevent this kind of damage, please check manufacturer of air conditioner if it's equipped with time-delay function before installation. Otherwise, this inverter/charger will trig overload fault and cut off output to protect your appliance but sometimes it still causes internal damage to the air conditioner.

**PV Connection**

**CAUTION:** Before connecting to PV modules, please install separately a DC circuit breaker between inverter and PV modules.

**WARNING!** All wiring must be performed by a qualified personnel.

**WARNING!** It's very important for system safety and efficient operation to use appropriate cable for PV module connection. To reduce risk of injury, please use the proper recommended cable size as below.

| Model                 | Typical Amperage | Cable Size | Torque    |
|-----------------------|------------------|------------|-----------|
| 2.2KW/3.2KW/3.5KW/4KW | 60A              | 8AWG       | 1.4~1.6Nm |

**PV Module Selection:**


When selecting proper PV modules, please be sure to consider below requirements first:


- 1. Open circuit Voltage (Voc) of PV modules not exceeds max. PV array open circuit voltage of inverter.
- 2. Open circuit Voltage (Voc) of PV modules should be higher than min. battery voltage.

| Solar Charging Mode                |              |
|------------------------------------|--------------|
| INVERTER MODEL                     | MPPT charger |
|                                    | 2.2-4KW      |
| Charging Current                   | 60A          |
| Max. PV Array Open Circuit Voltage | 160Vdc       |
| PV Array MPPT Voltage Range        | 30~128Vdc    |
| Min. battery voltage for PV charge | 17Vdc        |
| System DC voltage                  | 24Vdc        |

Please follow below steps to implement PV module connection:

- 1. Remove insulation sleeve 10 mm for positive and negative conductors.
- 2. Check correct polarity of connection cable from PV modules and PV input connectors. Then, connect positive pole (+) of connection cable to positive pole (+) of PV input connector. Connect negative pole (-) of connection cable to negative pole (-) of PV input connector.



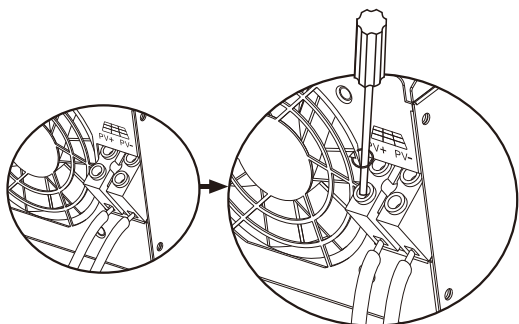


3. Make sure the wires are securely connected.

### Recommended PV module configuration

| PV Module Spec. (reference)                                                    | Inverter Model | Solar Input | Q'ty of modules |
|--------------------------------------------------------------------------------|----------------|-------------|-----------------|
| -250W<br>-Vmp:30.9Vdc<br>-Imp:8.42A<br>-Voc:37.7Vdc<br>-Isc:8.89A<br>-Cells:60 | MPPT-60A       | 3S3P        | 9PCS            |


### Solar panel installation schematic



### MPPT-60A

### Final Assembly

After connecting all wirings, please put bottom cover back by screwing two screws as shown below.

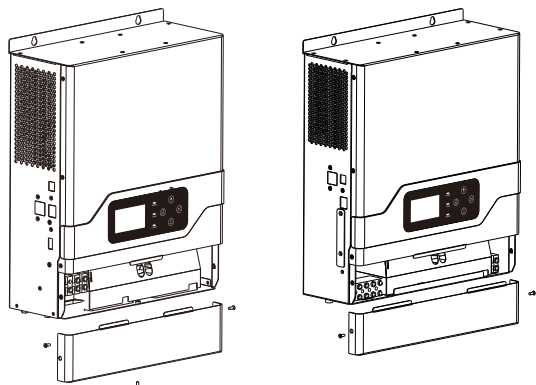

Communication Connection

Please use supplied communication cable to inverter and PC. Download the software by link on the last page of this manual into computer and follow on screen instruction to install the monitoring software. For the detailed software operation, please consult the seller if you have any questions.


**CAUTION:** Only the CAN prot can be used to communicate with the smart battery pack.You need to use CAN-L,CAN-H and GND to establish a connection.

**WARNING:** It's forbidden to use network cable as the communication cable to directly communicate with the PC port. Otherwise, the internal components of the controller will be damaged.

**WARNING:** RJ45 interface is only suitable for the use of the company’s supporting products or professional operation.

Below chart shows RJ45 Pins definition

| Pin | Definition |
|-----|------------|
| 1   | RS-485-B   |
| 2   | RS-485-A   |
| 3   | GND        |
| 4   | GND        |
| 5   | CAN-L      |
| 6   | CAN-H      |
| 7   |            |
| 8   |            |

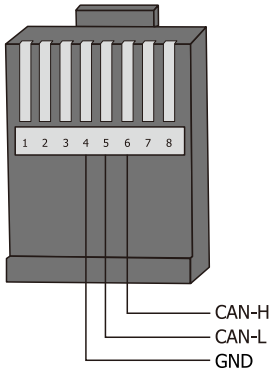


Dry Contact Signal

There is one dry contact (3A/250VAC) available on the rear panel. It could be used to deliver signal to external device when battery voltage reaches warning level.

| Unit status | Condition                                |                                                      |                                                                                                                                                                                    | Dry contact port:<br> |       |
|-------------|------------------------------------------|------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------|-------|
|             |                                          |                                                      |                                                                                                                                                                                    | NC&C                                                                                                    | NO&C  |
| Power Off   | Unit is off and no output is powered.    |                                                      |                                                                                                                                                                                    | Close                                                                                                   | Open  |
|             | output is powered from Utility           |                                                      |                                                                                                                                                                                    | Close                                                                                                   | Open  |
| Power On    | Output is powered from Battery or Solar. | Program 37=VOL                                       | Battery voltage<Low DC warning voltage<br>(If program 01 is set as SBU or SOL, low DC warning voltage= setting value in Program 21)<br>Battery voltage>Setting value in Program 21 | Open                                                                                                    | Close |
|             |                                          |                                                      |                                                                                                                                                                                    | Close                                                                                                   | Open  |
|             |                                          | Program 37=SOC<br>(BMS communication is established) | SOC of Lithium battery < Setting value in Program 38<br>SOC of Lithium battery>30%+ Setting value in Program 38                                                                    | Open                                                                                                    | Close |
|             |                                          |                                                      |                                                                                                                                                                                    | Close                                                                                                   | Open  |


**OPERATION**  
**Power ON/OFF**

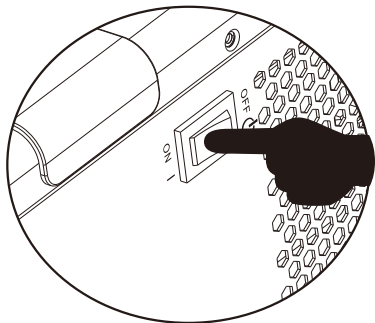

Once the unit has been properly installed and the batteries are connected well, simply press On/Off switch (located on the button of the case) to turn on the unit.

**Operation and Display Panel**

The operation and display panel, shown in below chart, is on the front panel of the inverter. It includes three indicators, four function keys and a LCD display, indicating the operating status and input/output power information.

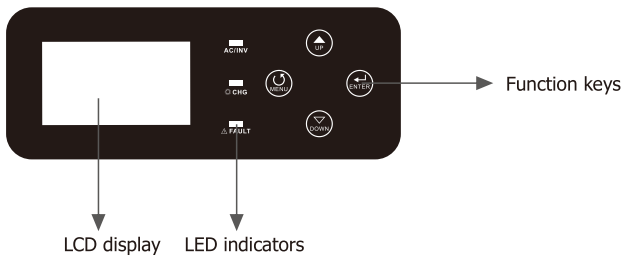


**LED Indicator**

| LED Indicator                                                                           |        |          | Messages                                            |
|-----------------------------------------------------------------------------------------|--------|----------|-----------------------------------------------------|
| AC/ INV                                                                                 | Green  | Solid On | Output is powered by grid in Line mode.             |
|                                                                                         |        | Flashing | Output is powered by battery or PV in battery mode. |
|  CHG   | Yellow | Flashing | Battery is charging or discharging.                 |
|  FAULT | Red    | Solid On | Fault occurs in the inverter.                       |
|                                                                                         |        | Flashing | Warning condition occurs in the inverter.           |

**Function Keys**

| Function Keys | Description                                                                                               |
|---------------|-----------------------------------------------------------------------------------------------------------|
| MENU          | Enter reset mode or setting mode go to previous selection.                                                |
| UP            | Increase the setting data.                                                                                |
| DOWN          | Decrease the setting data.                                                                                |
| ENTER         | Enter setting mode and Confirm the selection in setting mode go to next selection or exit the reset mode. |

LCD Display Icons

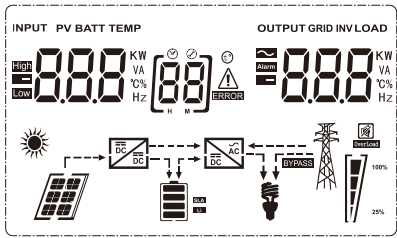

| Icon                                                                               | Function description                                                                                                     |                                                                        |
|------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------|
| Input Source Information and Output Information                                    |                                                                                                                          |                                                                        |
|    | Indicates the AC information.                                                                                            |                                                                        |
|    | Indicates the DC information.                                                                                            |                                                                        |
|    | Indicate input voltage, input frequency, PV voltage, battery voltage and charger current.                                |                                                                        |
|                                                                                    | Indicate output voltage, output frequency, load in VA, load in Watt and discharging current.                             |                                                                        |
| Configuration Program and Fault Information                                        |                                                                                                                          |                                                                        |
|    | Indicates the setting programs.                                                                                          |                                                                        |
|    | Indicates the warning and fault codes.                                                                                   |                                                                        |
|                                                                                    | Warning: flashing  ⚠ with warning code. |                                                                        |
|                                                                                    | Fault: lighting  with fault code.       |                                                                        |
| Battery Information                                                                |                                                                                                                          |                                                                        |
|  | Indicates battery level by 0-24%, 25-49%, 50-74% and 75-100% in battery mode and charging status in line mode.           |                                                                        |
| In AC mode, it will present battery charging status.                               |                                                                                                                          |                                                                        |
| Status                                                                             | Battery voltage                                                                                                          | LCD Display                                                            |
| Constant                                                                           | <2V/cell                                                                                                                 | 4 bars will flash in turns.                                            |
| Current mode / Constant Voltage mode                                               | 2 ~ 2.083V/cell                                                                                                          | Bottom bar will be on and the other three bars will flash in turns.    |
|                                                                                    | 2.083 ~ 2.167V/cell                                                                                                      | Bottom two bars will be on and the other two bars will flash in turns. |
|                                                                                    | > 2.167 V/cell                                                                                                           | Bottom three bars will be on and the top bar will flash.               |
| Batteries are fully charged.                                                       |                                                                                                                          | 4 bars will be on.                                                     |

| In battery mode, it will present battery capacity. |                          |                                                                                   |
|----------------------------------------------------|--------------------------|-----------------------------------------------------------------------------------|
| Load Percentage                                    | Battery Voltage          | LCD Display                                                                       |
| Load >50%                                          | < 1.717V/cell            |  |
|                                                    | 1.717V/cell ~ 1.8V/cell  |  |
|                                                    | 1.8 ~ 1.883V/cell        |  |
|                                                    | > 1.883 V/cell           |  |
| 50%> Load > 20%                                    | < 1.817V/cell            |  |
|                                                    | 1.817V/cell ~ 1.9V/cell  |  |
|                                                    | 1.9 ~ 1.983V/cell        |  |
|                                                    | > 1.983V/cell            |  |
| Load < 20%                                         | < 1.867V/cell            |  |
|                                                    | 1.867V/cell ~ 1.95V/cell |  |
|                                                    | 1.95 ~ 2.033V/cell       |  |
|                                                    | > 2.033V/cell            |  |

### Load Information

|                                                                                                                 |                                                                                    |                                                                                    |                                                                                    |                                                                                    |
|-----------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------|------------------------------------------------------------------------------------|------------------------------------------------------------------------------------|------------------------------------------------------------------------------------|
| <b>OVERLOAD</b>                                                                                                 | Indicates overload.                                                                |                                                                                    |                                                                                    |                                                                                    |
|  <div>100%</div> <div>25%</div> | Indicates the load level by 0-24%, 25-49%, 50-74% and 75-100%.                     |                                                                                    |                                                                                    |                                                                                    |
|                                                                                                                 | 0%~24%                                                                             | 25%~49%                                                                            | 50%~74%                                                                            | 75%~100%                                                                           |
|                                                                                                                 |  |  |  |  |

### Mode Operation Information

|                                                                                    |                                                  |
|------------------------------------------------------------------------------------|--------------------------------------------------|
|  | Indicates unit connected to the mains.           |
|  | Indicates unit connected to the PV panel.        |
| <b>BYPASS</b>                                                                      | Indicates load is supplied by utility power.     |
|  | Indicates the solar charger is working.          |
|  | Indicates the DC/AC inverter circuit is working. |

### Mute Operation

|                                                                                    |                                   |
|------------------------------------------------------------------------------------|-----------------------------------|
|  | Indicates unit alarm is disabled. |
|------------------------------------------------------------------------------------|-----------------------------------|

**LCD Setting**

After pressing and holding "ENTER" button for 2 seconds, the unit will enter setting mode. Press "UP"or "DOWN" button to select setting programs. And then, press "ENTER" or "MENU" button to confirm the selection and exit.

**Setting Programs:**

| Program | Description                      | Selectable option    |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |
|---------|----------------------------------|----------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 00      | Exit setting mode                | Escape<br>[00] ESC   |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |
| 01      | Output source priority selection | [01] SBU             | Solar energy provides power to the loads as first priority. If battery voltage has been higher than the setting point in program 21/39 for 5 minutes, the inverter will turn to battery mode, solar and battery will provide power to the load at the same time. When the battery voltage drops to the setting point in program 20/38, the inverter will turn to bypass mode, utility provides power to the load only, and the solar will charge the battery at the same time.                                                            |
|         |                                  | [01] SOL             | Solar energy provides power to the loads as first priority. If battery voltage has been higher than the setting point in program 21/39 for 5 minutes, and the solar energy has been available for 5 minutes too, the inverter will turn to battery mode, solar and battery will provide power to the load at the same time. When the battery voltage drops to the setting point in program 20/38, the inverter will turn to bypass mode, utility provides power to the load only, and the solar will charge the battery at the same time. |
|         |                                  | (default)<br>[01] UT | Utility will provide power to the loads as first priority. Solar and battery energy will provide power to the loads only when utility power is not available.                                                                                                                                                                                                                                                                                                                                                                             |

|    |                                                                                                        |                                                                                                                |                                                                                                                          |
|----|--------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|
| 02 | AC input voltage range                                                                                 | Appliances (default)<br>[02] RPL                                                                               | If selected, acceptable AC input voltage range will be within 90-280VAC.                                                 |
|    |                                                                                                        | UPS<br>[02] UPS                                                                                                | If selected, acceptable AC input voltage range will be within 170-280VAC.                                                |
|    |                                                                                                        | VDE<br>[02] VDE                                                                                                | If selected, acceptable AC input voltage range will conform to VDE4105(184VAC-253VAC).                                   |
|    |                                                                                                        | GEN<br>[02] GEN                                                                                                | When the user uses the device to connect the generator, select the generator mode.                                       |
| 03 | Output voltage                                                                                         | [03] 230 <sup>v</sup>                                                                                          | Set the output voltage amplitude, (220VAC-240VAC).                                                                       |
| 04 | Output frequency                                                                                       | 50HZ(default)<br>[04] 500                                                                                      | 60HZ<br>[04] 600                                                                                                         |
| 05 | Solar supply priority                                                                                  | [05] BLU                                                                                                       | Solar energy provides power to charge battery as first priority.                                                         |
|    |                                                                                                        | (default)<br>[05] LBU                                                                                          | Solar energy provides power to the loads as first priority.                                                              |
| 06 | Overload bypass: When enabled, the unit will transfer to line mode if overload occurs in battery mode. | Bypass disable<br>[06] BYD                                                                                     | Bypass enable (default)<br>[06] BYE                                                                                      |
| 07 | Auto restart when overload occurs                                                                      | Restart disable (default)<br>[07] LTD                                                                          | Restart enable<br>[07] LTE                                                                                               |
| 08 | Auto restart when over temperature occurs                                                              | Restart disable (default)<br>[08] LTD                                                                          | Restart enable<br>[08] LTE                                                                                               |
| 10 | Charger source priority: To configure charger source priority                                          | If this inverter/charger is working in Line, Standby or Fault mode, charger source can be programmed as below: |                                                                                                                          |
|    |                                                                                                        | Solar first<br>[10] CSO                                                                                        | Solar energy will charge battery as first priority. Utility will charge battery only when solar energy is not available. |
|    |                                                                                                        | Solar and Utility (default)<br>[10] SNU                                                                        | Solar energy and utility will charge battery at the same time.                                                           |

|    |                                                                                                                |                                                                                                                                                                                    |                                                                                                                                                                                                                                                       |
|----|----------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|    |                                                                                                                | Only Solar<br>[10] 050                                                                                                                                                             | Solar energy will be the only charger source no matter utility is available or not.                                                                                                                                                                   |
|    |                                                                                                                | If this inverter/charger is working in Battery mode or Power saving mode, only solar energy can charge battery. Solar energy will charge battery if it's available and sufficient. |                                                                                                                                                                                                                                                       |
| 11 | Maximum solar charging current<br>(Max. charging current=utility charging current+solar charging current)      | 2-4KW<br>60A (default)<br>[1] 60 A                                                                                                                                                 | Setting range is from 1 A to 60A.<br>Increment of each click is 1A.                                                                                                                                                                                   |
| 13 | Maximum utility charging current<br>(Max. charging current= utility charging current + solar charging current) | 2.2KW<br>20A (default)<br>[13] 20 A                                                                                                                                                | 40A(Maximum current)<br>Setting range is from 1 A to 40A.<br>Increment of each click is 1A.                                                                                                                                                           |
|    |                                                                                                                | 3.2KW/3.5KW/4KW<br>30A (default)<br>[13] 30 A                                                                                                                                      | 60A(Maximum current)<br>Setting range is from 1 A to 60A.<br>Increment of each click is 1A.                                                                                                                                                           |
| 14 | Battery type                                                                                                   | AGM (default)<br>[14] AGM<br>GEL<br>[14] GEL<br>Lithium Ion<br>[14] LI                                                                                                             | Flooded<br>[14] FLd<br>LEAD<br>[14] LEA<br>User-Defined<br>[14] USE<br>If "User-Defined" LI is selected, battery charge voltage and low DC cut-off voltage can be set up in program 17, 18 and 19.Low DC warning voltage can be set up in program 20. |
| 17 | Bulk charging voltage<br>(C.V voltage)                                                                         | default setting: 28.2V<br>[17] CV 28.2 V                                                                                                                                           | If "User-Defined" LI is selected in program 14, this program can be set up. Setting range is from 24.0V to 29.2V. Increment of each click is 0.1V.                                                                                                    |
| 18 | Floating charging voltage                                                                                      | default setting: 27.0V<br>[18] FLV 27.0 V                                                                                                                                          | If "User-Defined" LI is selected in program 14, this program can be set up, Setting range is from 24.0V to 29.2V. Increment of each click is 0.1V.                                                                                                    |

|    |                                                                                                                        |                                                                                                                                                                                                                                  |                                                                                                                                                                                                                             |
|----|------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 19 | Low DC cut off battery voltage setting                                                                                 | default setting: 20.4V<br>[19] 20.4 <sup>v</sup>                                                                                                                                                                                 |                                                                                                                                                                                                                             |
|    |                                                                                                                        | If "User-Defined" "LI" is selected in program 14, this program can be set up. Setting range is from 20V to 24.0V for 24Vdc model. Increment of each click is 0.1V.                                                               |                                                                                                                                                                                                                             |
|    |                                                                                                                        | SOC 10% (default)<br>SOC [19] 10 %                                                                                                                                                                                               |                                                                                                                                                                                                                             |
|    |                                                                                                                        | If "User-Defined" "LI" is selected in program 14, and the SOC percentage method is selected in program 37, the low DC cut-off SOC percentage will be able to be set. Setting range is from 0%-90%. Increment of each click is 1% |                                                                                                                                                                                                                             |
|    |                                                                                                                        | Low DC cut-off voltage/SOC percentage will be fixed to setting value no matter what percentage of load is connected                                                                                                              |                                                                                                                                                                                                                             |
| 20 | Low DC warning and battery stop discharging voltage when grid is available                                             | 23V (default)<br>[20] 23.0 <sup>v</sup>                                                                                                                                                                                          | Setting range is from 22.0V to 29.0V. Increment of each click is 0.1V.<br>If "User-Defined" LI is selected in program 14, this program can be set up. Low DC warning voltage will be fixed to setting value.                |
|    |                                                                                                                        |                                                                                                                                                                                                                                  |                                                                                                                                                                                                                             |
| 21 | Low DC warning recover and battery stop charging voltage when grid is available                                        | 26.4V (default)<br>[21] 26.4 <sup>v</sup>                                                                                                                                                                                        | Setting range is from 22.0V to 29.0V. Increment of each click is 0.1V. Low DC warning recover voltage will be fixed to setting value no matter what kind of battery type was selected.                                      |
|    |                                                                                                                        |                                                                                                                                                                                                                                  |                                                                                                                                                                                                                             |
| 22 | Auto turn page                                                                                                         | (default)<br>[22] PLE                                                                                                                                                                                                            | If selected, the display screen will auto turn the display page.                                                                                                                                                            |
|    |                                                                                                                        | [22] PLd                                                                                                                                                                                                                         | If selected, the display screen will stay at latest screen user finally switches.                                                                                                                                           |
| 23 | Backlight control                                                                                                      | Backlight on<br>[23] LON                                                                                                                                                                                                         | Backlight off (default)<br>[23] LOF                                                                                                                                                                                         |
|    |                                                                                                                        |                                                                                                                                                                                                                                  |                                                                                                                                                                                                                             |
| 24 | Alarm control                                                                                                          | Alarm on (default)<br>[24] bON                                                                                                                                                                                                   | Alarm off<br>[24] bOF                                                                                                                                                                                                       |
|    |                                                                                                                        |                                                                                                                                                                                                                                  |                                                                                                                                                                                                                             |
| 25 | Beeps while primary source is interrupted                                                                              | Alarm on<br>[25] AON                                                                                                                                                                                                             | Alarm off (default)<br>[25] AOF                                                                                                                                                                                             |
|    |                                                                                                                        |                                                                                                                                                                                                                                  |                                                                                                                                                                                                                             |
| 27 | Record Fault code                                                                                                      | Record enable (default)<br>[27] FON                                                                                                                                                                                              | Record disable<br>[27] FOF                                                                                                                                                                                                  |
|    |                                                                                                                        |                                                                                                                                                                                                                                  |                                                                                                                                                                                                                             |
| 28 | Solar power balance: When enabled, solar input power will be automatically adjusted according to connected load power. | Solar power balance enable<br>[28] S6E                                                                                                                                                                                           | If selected, the solar input power will be automatically adjusted according to the following formula:<br>Max. Input solar power = Max. battery charging power + Connected load power when the machine in OffGrid workstate. |
|    |                                                                                                                        |                                                                                                                                                                                                                                  |                                                                                                                                                                                                                             |

|    |                                                                     |                                                                                                                                                                                                                                                                                                                                                                                                                                            |                                                                                                                                                                                                                                                                 |
|----|---------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|    |                                                                     | Solar power balance disable (default)<br>[28] 5bd                                                                                                                                                                                                                                                                                                                                                                                          | If selected, the solar input power will be the same to max. Battery charging power no matter how much loads are connected. The max.battery charging power will be based on the setting current in program 11 ( Max. solar power = Max.battery charging power ). |
| 30 | Battery equalization                                                | Battery equalization<br>[30] EEn                                                                                                                                                                                                                                                                                                                                                                                                           | Battery equalization disable(default)<br>[30] EdS                                                                                                                                                                                                               |
| 31 | Battery equalization voltage                                        | default setting:28.8V<br>[31] E <sup>4</sup>                                                                                                                                                                                                                                                                                                                                                                                               | 288 <sup>v</sup>                                                                                                                                                                                                                                                |
|    |                                                                     | Setting range is from 24.0V to 29.2V.<br>Increment of each click is 0.1V.                                                                                                                                                                                                                                                                                                                                                                  |                                                                                                                                                                                                                                                                 |
| 33 | Battery equalization time                                           | 60min(default)<br>[33] 60                                                                                                                                                                                                                                                                                                                                                                                                                  | Setting range is from 5 min to 900min.<br>Increment of each click is 5min.                                                                                                                                                                                      |
| 34 | Battery equalization timeout                                        | 120min(default)<br>[34] 120                                                                                                                                                                                                                                                                                                                                                                                                                | Setting range is from 5 min to 900min.<br>Increment of each click is 5min.                                                                                                                                                                                      |
| 35 | Equalization interval                                               | 30days(default)<br>[35] 30d                                                                                                                                                                                                                                                                                                                                                                                                                | Setting range is from 0 to 90days.<br>Increment of each click is 1 day.                                                                                                                                                                                         |
| 36 | Equalization activated immediately                                  | Enable<br>[36] AEn                                                                                                                                                                                                                                                                                                                                                                                                                         | Disable(default)<br>[36] AdS                                                                                                                                                                                                                                    |
|    |                                                                     | If equalization function is enabled in program 30, this program can be set up. If "Enable" is selected in this program, it's to activate battery equalization immediately and LCD main page will shows " E <sup>4</sup> ". If "Disable" is selected, it will cancel equalization function until next activated equalization time arrives based on program 35 setting. At this time, " E <sup>4</sup> " will be shown in LCD main page too. |                                                                                                                                                                                                                                                                 |
| 37 | BMS control method                                                  | Voltage method(default)<br>[37] 40L                                                                                                                                                                                                                                                                                                                                                                                                        | SOC Percent method<br>[37] 50C                                                                                                                                                                                                                                  |
| 38 | SBU mode:<br>Battery stop discharging percent When SOC is available | 20 % (default)<br>[38] 20 %                                                                                                                                                                                                                                                                                                                                                                                                                | Setting range is from 5% to 95%<br>Increment of each click is 1%.                                                                                                                                                                                               |
| 39 | SBU mode:<br>Battery stop charging percent When SOC is available    | 95 % (default)<br>[39] 95 %                                                                                                                                                                                                                                                                                                                                                                                                                | Setting range is from 10% to 100%<br>Increment of each click is 1%.                                                                                                                                                                                             |

|    |                          |                                                                                                                                                                                                                                         |                                                                                                                          |
|----|--------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|
| 40 | BMS communication        | (default)<br>[40] 1dP                                                                                                                                                                                                                   | when the communication between BMS and converter is faulted ,the converter still charge or discharge from the battery    |
|    |                          | [40] Un1                                                                                                                                                                                                                                | when the communication between BMS and converter is faulted ,the converter stop charging or discharging from the battery |
| 41 | Lithium battery protocol | SEL[40] 0                                                                                                                                                                                                                               | Setting range is from 0 to 31<br>Increment of each click is 1                                                            |
|    |                          | If LI is selected in program 14, program 41 can be set. After the program 41 is set, please restart the inverter to take effect. For example,if you set the program 41 to 0,the inverter can communicate with the MUST lithium battery. |                                                                                                                          |

After pressing and holding "MENU" button for 6 seconds, the unit will enter reset model. Press "Up"and "DOWN" button to select programs. And then ,press "ENTER" button to exit.

|     |                       |                        |
|-----|-----------------------|------------------------|
| SEL | (default)<br>[dt] nrt | Reset setting disable. |
|     | [dt] t5t              | Reset setting enable.  |

### Fault Reference Code





| Fault Code | Fault Event                                                    | Icon on                                                                                  |
|------------|----------------------------------------------------------------|------------------------------------------------------------------------------------------|
| 01         | Fan is locked when inverter is off                             | [01]    |
| 02         | Inverter transformer over temperature                          | [02]    |
| 03         | Battery voltage is too high or AC input L/N wires are reversed | [03]   |
| 04         | Battery voltage is too low                                     | [04]  |
| 05         | Output short circuited                                         | [05]  |
| 06         | Inverter output voltage is high                                | [06]  |
| 07         | Overload time out                                              | [07]  |
| 08         | Inverter bus voltage is too high                               | [08]  |
| 09         | Bus soft start failed                                          | [09]  |





|    |                                                                         |                                                                                          |
|----|-------------------------------------------------------------------------|------------------------------------------------------------------------------------------|
| 11 | Main relay failed                                                       | [11]    |
| 21 | Inverter output voltage sensor error                                    | [21]    |
| 22 | Inverter grid voltage sensor error                                      | [22]    |
| 23 | Inverter output current sensor error                                    | [23]    |
| 24 | Inverter grid current sensor error                                      | [24]    |
| 25 | Inverter load current sensor error                                      | [25]    |
| 26 | Inverter grid over current error                                        | [26]    |
| 27 | Inverter radiator over temperature                                      | [27]    |
| 31 | Solar charger battery voltage class error                               | [31]    |
| 32 | Solar charger current sensor error                                      | [32]    |
| 33 | Solar charger current is uncontrollable                                 | [33]    |
| 41 | Inverter grid voltage is low                                            | [41]    |
| 42 | Inverter grid voltage is high                                           | [42]    |
| 43 | Inverter grid under frequency                                           | [43]    |
| 44 | Inverter grid over frequency                                            | [44]    |
| 51 | Inverter over current protection error                                  | [51]   |
| 52 | Inverter bus voltage is too low or component temperature is too high    | [52]  |
| 53 | Inverter soft start failed                                              | [53]  |
| 55 | Over DC voltage in AC output                                            | [55]  |
| 56 | Battery connection is open                                              | [56]  |
| 57 | Inverter control current sensor error                                   | [57]  |
| 58 | Inverter output voltage is too low or component temperature is too high | [58]  |

**Warning Indicator**

| Fault Code | Fault Event                                 | Icon on                                                                                         |
|------------|---------------------------------------------|-------------------------------------------------------------------------------------------------|
| 61         | Fan is locked when inverter is on.          | [61] ⚠️ ERROR                                                                                   |
| 62         | Fan 2 is locked when inverter is on.        | [62] ⚠️ ERROR                                                                                   |
| 63         | Battery is over-charged.                    | [63] ⚠️ ERROR                                                                                   |
| 64         | Low battery.                                | [64] ⚠️ ERROR                                                                                   |
| 67         | Overload.                                   | [67] ⚠️ ERROR  |
| 70         | Output power derating.                      | [70] ⚠️ ERROR                                                                                   |
| 72         | Solar charger stops due to low battery.     | [72] ⚠️ ERROR                                                                                   |
| 73         | Solar charger stops due to high PV voltage. | [73] ⚠️ ERROR                                                                                   |
| 74         | Solar charger stops due to over load.       | [74] ⚠️ ERROR                                                                                   |
| 75         | Solar charger over temperature.             | [75] ⚠️ ERROR                                                                                   |
| 76         | PV charger communication error.             | [76] ⚠️ ERROR                                                                                   |
| 77         | Parameter error.                            | [77] ⚠️ ERROR                                                                                   |

**Operating State Description**

| Operation state   | Description                                                                                       | LCD display                                                                                      |
|-------------------|---------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------|
| Utility-Tie state | PV energy is charger into the battery and utility provide power to the AC load.                   | PV is on<br>  |
|                   |                                                                                                   | PV is off<br> |
| Charge state      | PV energy and grid can charge batteries.                                                          |               |
| Bypass state      | Error are caused by inside circuit error or external reasons such as over temperature, and so on. |               |

|                |                                                                                                                           |                                                                                                                                      |
|----------------|---------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------|
| Off-Grid state | The inverter will provide output power from battery and PV power.                                                         | Inverter power loads from PV energy<br>             |
|                |                                                                                                                           | Inverter power loads from battery and PV energy<br> |
|                |                                                                                                                           | Inverter power loads from battery only<br>          |
| Stop mode      | The inverter stop working if you turn off the inverter by the soft key or error has occurred in the condition of no grid. |                                                     |

Display Setting

The LCD display information will be switched in turns by pressing "UP" or "DOWN" key. The selectable information is switched as below order: battery voltage, battery current ,inverter voltage, inverter current, grid voltage, grid current, load in Watt, load in VA, grid frequency, inverter frequency, PV voltage, PV charging power, PV charging output voltage, PV charging current.

| Selectable information                              | LCD display                                   |                                               |
|-----------------------------------------------------|-----------------------------------------------|-----------------------------------------------|
| Battery voltage/DC discharging current              | <div>BATT</div> <div>26.0<sup>V</sup></div>   | <div>48.0<sup>A</sup></div>                   |
| Inverter output voltage/Inverter output current     | <div>22.9<sup>V</sup></div>                   | <div>INV</div> <div>6.70<sup>A</sup></div>    |
| Grid voltage/Grid current                           | <div>22.9<sup>V</sup></div>                   | <div>3.0<sup>A</sup></div>                    |
| Load in Watt/VA                                     | <div>15.0<sup>KW</sup></div>                  | <div>LOAD</div> <div>16.8<sup>KVA</sup></div> |
| Grid frequency/Inverter frequency                   | <div>INPUT</div> <div>50.0<sup>Hz</sup></div> | <div>INV</div> <div>50.0<sup>Hz</sup></div>   |
| PV voltage and power                                | <div>PV</div> <div>6.10<sup>V</sup></div>     | <div>1.00<sup>KW</sup></div>                  |
| PV charger output voltage and MPPT charging current | <div>PV</div> <div>25.0<sup>V</sup></div>     | <div>OUTPUT</div> <div>4.00<sup>A</sup></div> |

SPECIFICATIONS


Table 1 Line Mode Specifications

| INVERTER MODEL                                                                                                      | 2.2KW                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      | 3.2KW | 3.5KW | 4KW |
|---------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------|-------|-----|
| Input Voltage Waveform                                                                                              | Sinusoidal (utility or generator)                                                                                                                                                                                                                                                                                                                                                                                                                                                          |       |       |     |
| Nominal Input Voltage                                                                                               | 230Vac                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |       |       |     |
| Low Loss Voltage                                                                                                    | 90Vac±7V(APL,GEN); 170Vac±7V(UPS)<br>186Vac±7V(VDE)                                                                                                                                                                                                                                                                                                                                                                                                                                        |       |       |     |
| Low Loss Return Voltage                                                                                             | 100Vac±7V(APL,GEN);180Vac±7V(UPS)<br>196Vac±7V(VDE)                                                                                                                                                                                                                                                                                                                                                                                                                                        |       |       |     |
| High Loss Voltage                                                                                                   | 280Vac±7V(APL, UPS,GEN)<br>253Vac±7V(VDE)                                                                                                                                                                                                                                                                                                                                                                                                                                                  |       |       |     |
| High Loss Return Voltage                                                                                            | 270Vac±7V(APL,UPS,GEN)<br>250Vac±7V(VDE)                                                                                                                                                                                                                                                                                                                                                                                                                                                   |       |       |     |
| Max AC Input Voltage                                                                                                | 300Vac                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |       |       |     |
| Nominal Input Frequency                                                                                             | 50Hz / 60Hz (Auto detection)                                                                                                                                                                                                                                                                                                                                                                                                                                                               |       |       |     |
| Low Loss Frequency                                                                                                  | 40Hz±1Hz(APL,UPS,GEN)<br>47.5Hz±0.05HZ(VDE)                                                                                                                                                                                                                                                                                                                                                                                                                                                |       |       |     |
| Low Loss Return Frequency                                                                                           | 42Hz±1Hz(APL,UPS,GEN)<br>47.5Hz±0.05HZ(VDE)                                                                                                                                                                                                                                                                                                                                                                                                                                                |       |       |     |
| High Loss Frequency                                                                                                 | 65Hz±1Hz(APL,UPS,GEN)<br>51.5Hz±0.05HZ(VDE)                                                                                                                                                                                                                                                                                                                                                                                                                                                |       |       |     |
| High Loss Return Frequency                                                                                          | 63Hz±1Hz(APL,UPS,GEN)<br>50.05Hz±0.05Hz(VDE)                                                                                                                                                                                                                                                                                                                                                                                                                                               |       |       |     |
| Output Short Circuit Protection                                                                                     | Line mode: Circuit Breaker<br>Battery mode: Electronic Circuits                                                                                                                                                                                                                                                                                                                                                                                                                            |       |       |     |
| Efficiency (Line Mode)                                                                                              | >95% ( Rated R load, battery full charged )                                                                                                                                                                                                                                                                                                                                                                                                                                                |       |       |     |
| Transfer Time                                                                                                       | 10ms typical (UPS,VDE)<br>20ms typical (APL)                                                                                                                                                                                                                                                                                                                                                                                                                                               |       |       |     |
| Output power derating:<br>When AC input voltage drops to 170V depending on models, the output power will be derated | <p>230Vac model:</p> <p>The graph illustrates the output power derating for a 230Vac model. The vertical axis represents Output Power, with specific markers for 50% Power and Rated Power. The horizontal axis represents AC Input Voltage, with markers at 90V, 170V, and 280V. The power remains at the Rated Power level from 280V down to 170V. Between 170V and 90V, the power is derated linearly, reaching 50% of the Rated Power at 90V. Below 90V, the output power is zero.</p> |       |       |     |

Table 2 Inverter Mode Specifications

| INVERTER MODEL                | 2.2KW                                                       | 3.2KW | 3.5KW                                                       | 4KW   |
|-------------------------------|-------------------------------------------------------------|-------|-------------------------------------------------------------|-------|
| Rated Output Power            | 2200W                                                       | 3200W | 3500W                                                       | 4000W |
| Output Voltage Waveform       | Pure Sine Wave                                              |       |                                                             |       |
| Output Voltage Regulation     | 230Vac±5%                                                   |       |                                                             |       |
| Output Frequency              | 60Hz or 50Hz                                                |       |                                                             |       |
| Peak Efficiency               | 92%                                                         |       |                                                             |       |
| Overload Protection           | <1s@≥130%load;<br>10s@110%~130% load;<br>30s@105%~110% load |       | <1s@≥140%load;<br>10s@115%~140% load;<br>30s@105%~115% load |       |
| Nominal DC Input Voltage      | 24Vdc                                                       |       |                                                             |       |
| Cold Start Voltage            | 23.0Vdc                                                     |       |                                                             |       |
| Low DC Warning Voltage        | 22.0Vdc<br>21.4Vdc<br>20.2Vdc                               |       |                                                             |       |
| @ load < 20%                  |                                                             |       |                                                             |       |
| @ 20% ≤ load < 50%            |                                                             |       |                                                             |       |
| @ load ≥ 50%                  |                                                             |       |                                                             |       |
| Low DC Warning Return Voltage | 23.0Vdc<br>22.4Vdc<br>21.2Vdc                               |       |                                                             |       |
| @ load < 20%                  |                                                             |       |                                                             |       |
| @ 20% ≤ load < 50%            |                                                             |       |                                                             |       |
| @ load ≥ 50%                  |                                                             |       |                                                             |       |
| Low DC Cut-off Voltage        | 21.0Vdc<br>20.4Vdc<br>19.2Vdc                               |       |                                                             |       |
| @ load < 20%                  |                                                             |       |                                                             |       |
| @ 20% ≤ load < 50%            |                                                             |       |                                                             |       |
| @ load ≥ 50%                  |                                                             |       |                                                             |       |
| High DC Recovery Voltage      | 29Vdc                                                       |       |                                                             |       |
| High DC Cut-off Voltage       | 30Vdc                                                       |       |                                                             |       |

Table 3 Charge Mode Specifications
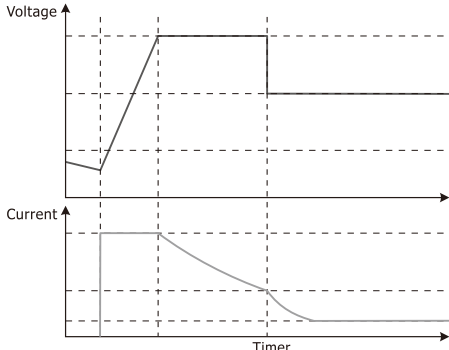
| Utility Charging Mode                    |                        |                                                                                    |           |       |     |
|------------------------------------------|------------------------|------------------------------------------------------------------------------------|-----------|-------|-----|
| INVERTER MODEL                           |                        | 2.2KW                                                                              | 3.2KW     | 3.5KW | 4KW |
| Charging Current @Nominal Input Voltage  |                        | 40A(± 4A)                                                                          | 60A(± 4A) |       |     |
| Floating charging voltage                | AGM / Gel/LEAD Battery | 27.4Vdc                                                                            |           |       |     |
|                                          | Flooded Battery        | 27.4Vdc                                                                            |           |       |     |
| Bulk charging voltage (C.V voltage)      | AGM / Gel/LEAD Battery | 28.8Vdc                                                                            |           |       |     |
|                                          | Flooded Battery        | 28.4Vdc                                                                            |           |       |     |
| Charging Algorithm                       |                        | 3-Step(Flooded Battery, AGM/Gel Battery), 4-Step(LI)                               |           |       |     |
| Solar Charging Mode                      |                        |                                                                                    |           |       |     |
| INVERTER MODEL                           |                        | 2.2KW                                                                              | 3.2KW     | 3.5KW | 4KW |
| Charging Current                         |                        | MPPT-60A                                                                           |           |       |     |
| System DC Voltage                        |                        | 24Vdc                                                                              |           |       |     |
| Operating Voltage Range                  |                        | 30-128Vdc                                                                          |           |       |     |
| Max.PV Array Open Circuit Voltage        |                        | 160Vdc                                                                             |           |       |     |
| Standby Power Consumption                |                        | 2W                                                                                 |           |       |     |
| Battery Voltage Accuracy                 |                        | +/-0.3%                                                                            |           |       |     |
| PV Voltage Accuracy                      |                        | +/-2V                                                                              |           |       |     |
| Charging Algorithm                       |                        | 3-Step(Flooded Battery, AGM/Gel Battery),4-Step(LI)                                |           |       |     |
| Charging algorithm for lead acid battery |                        |  |           |       |     |

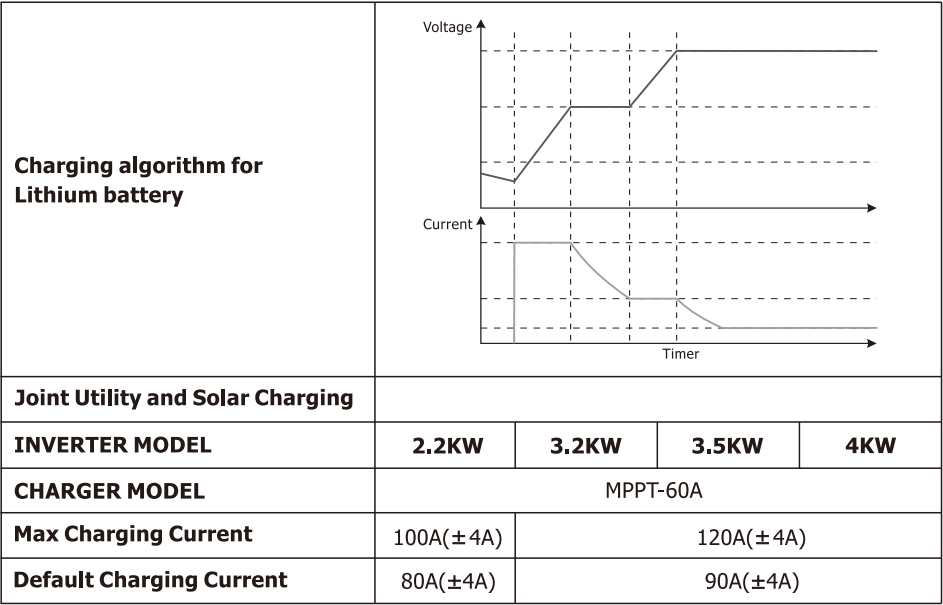


Table 4 General Specifications

| INVERTER MODEL              | 2.2KW             | 3.2KW | 3.5KW         | 4KW |
|-----------------------------|-------------------|-------|---------------|-----|
| Safety Certification        | CE                |       |               |     |
| Operating Temperature Range | -10°C to 50°C     |       |               |     |
| Storage temperature         | -15°C~ 60°C       |       |               |     |
| Dimension (D*W*H), mm       | 367.6x289.8x120.9 |       | 367.4x318x121 |     |
| Net Weight, kg              | 5.8               |       | 6.2           |     |

## TROUBLE SHOOTING

| Problem                                                                       | LCD/LED/Buzzer                                                          | Explanation/Possible cause                                                                         | What to do                                                                                                                                                                   |
|-------------------------------------------------------------------------------|-------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Unit shuts down automatically during startup process.                         | LCD/LEDs and buzzer will be active for 3 seconds and then complete off. | The battery voltage is too low. (<1.91V/Cell)                                                      | 1. Re-charge battery.<br>2. Replace battery.                                                                                                                                 |
| No response after power on.                                                   | No indication.                                                          | 1. The battery voltage is far too low. (<1.4V/Cell)<br>2. Battery polarity is connection reversed. | 1. Check if batteries and the wires are connected properly.<br>2. Re-charge battery.<br>3. Replace battery.                                                                  |
| Mains exist but the unit works in battery mode.                               | Input voltage is displayed as 0 on the LCD and green LED is flashing.   | Input protector is tripped.                                                                        | Check if AC breaker is tripped or AC wiring is connected right .                                                                                                             |
|                                                                               | Green LED is flashing.                                                  | Insufficient quality of AC power. (Shore or Generator)                                             | 1. Check if AC wires are too thin and/or too long.<br>2. Check generator (if applied) is working well or check if input voltage range setting is correct. (Appliance – Wide) |
| When the unit is turned on, internal relay is switched on and off repeatedly. | LCD display and LED are flashing.                                       | Battery is disconnected.                                                                           | Check if battery wires are connected right .                                                                                                                                 |
| Buzzer beeps continuously and red LED is on.                                  | Fault code 07                                                           | Overload error. The inverter is overload 110%and time is up.                                       | Reduce the connected load by switching off some equipment.                                                                                                                   |
|                                                                               | Fault code 05                                                           | Output short circuited.                                                                            | Check if wiring is connected right and remove abnormal load.                                                                                                                 |
|                                                                               | Fault code 02                                                           | Internal temperature of inverter component is over 90°C.                                           | Check whether the air flow of the unit is blocked or whether the ambient temperature is too high.                                                                            |
|                                                                               | Fault code 03                                                           | Battery is over charged.                                                                           | Return to repair center.                                                                                                                                                     |
|                                                                               |                                                                         | The battery voltage is too high.                                                                   | Check if spec and quantity of batteries meet requirements.                                                                                                                   |
|                                                                               |                                                                         | AC input L/N wires are reversed                                                                    | Check AC input.                                                                                                                                                              |
|                                                                               | Fault code 01                                                           | Fan fault.                                                                                         | Replace the fan.                                                                                                                                                             |
|                                                                               | Fault code 06/58                                                        | Output abnormal .(Inverter voltage below than 95Vac or is higher than 150Vac)                      | 1. Reduce the connected load.<br>2. Return to repair center                                                                                                                  |
|                                                                               | Fault code 08/09/53/57                                                  | Internal components failed.                                                                        | Return to repair center                                                                                                                                                      |
|                                                                               | Fault code 51                                                           | Over current or surge.                                                                             | Reduce the connected load.                                                                                                                                                   |
|                                                                               | Fault code 52                                                           | Inverter bus voltage is too low or component temperature is to high.                               | Restart the unit, if the error happens again, please return to repair center.                                                                                                |
|                                                                               | Fault code 55                                                           | Output voltage is unbalanced.                                                                      |                                                                                                                                                                              |
|                                                                               | Fault code 56                                                           | Battery is not connected right or fuse is burnt.                                                   | If the battery is connected well, please return to repair center.                                                                                                            |

**Appendix: Approximate Back-up Time Table**

| Model                           | Load (W) | Backup Time @ 24Vdc 100Ah (min) | Backup Time @ 24Vdc 200Ah (min) |
|---------------------------------|----------|---------------------------------|---------------------------------|
| 2.2KW                           | 200      | 766                             | 1610                            |
|                                 | 400      | 335                             | 766                             |
|                                 | 600      | 198                             | 503                             |
|                                 | 800      | 139                             | 339                             |
|                                 | 1000     | 112                             | 269                             |
|                                 | 1200     | 95                              | 227                             |
|                                 | 1400     | 81                              | 176                             |
|                                 | 1600     | 62                              | 140                             |
|                                 | 1800     | 55                              | 125                             |
|                                 | 2000     | 50                              | 112                             |
| 3.2KW<br>/<br>3.5KW<br>/<br>4KW | 300      | 449                             | 1100                            |
|                                 | 600      | 222                             | 525                             |
|                                 | 900      | 124                             | 303                             |
|                                 | 1200     | 95                              | 227                             |
|                                 | 1500     | 68                              | 164                             |
|                                 | 1800     | 56                              | 126                             |
|                                 | 2100     | 48                              | 108                             |
|                                 | 2400     | 35                              | 94                              |
|                                 | 2700     | 31                              | 74                              |
|                                 | 3000     | 28                              | 67                              |
|                                 | 3500     | 22                              | 50                              |

**Note:** Backup time depends on the quality of the battery, age of battery and type of battery. Specifications of batteries may vary depending on different manufacturers.



**MUST<sup>®</sup>**

## GUARANTEE CERTIFICATE

Serial No.: \_\_\_\_\_

|                  |  |           |                    |                |  |
|------------------|--|-----------|--------------------|----------------|--|
| Customer's Name  |  |           |                    | Contact Person |  |
| Address          |  |           |                    | Telephone No.  |  |
| Product/Model:   |  | Post Code |                    | Fax No.        |  |
| Date of purchase |  |           | Expire Date        |                |  |
| Dealer Signature |  |           | Customer Signature |                |  |

**MUST<sup>®</sup>**

## GUARANTEE CERTIFICATE

Serial No.: \_\_\_\_\_

|                  |  |           |                    |                |  |
|------------------|--|-----------|--------------------|----------------|--|
| Customer's Name  |  |           |                    | Contact Person |  |
| Address          |  |           |                    | Telephone No.  |  |
| Product/Model:   |  | Post Code |                    | Fax No.        |  |
| Date of purchase |  |           | Expire Date        |                |  |
| Dealer Signature |  |           | Customer Signature |                |  |